

Construction Stormwater Spill Plan and Action Guidance

First and Foremost:

- A plan must be in place to address any materials that have the potential to spill at your site.
- Any spill must be contained immediately, cleaned up, and disposed of properly.

Primary Considerations for Your Spill Response Plan:

- ✓ Make it clear to all who is your qualified individual in charge of spill prevention and cleanup.
- ✓ Clearly mark and educate personnel on location of cleanup equipment.
- ✓ Store cleanup equipment close to potential hazards and materials with potential to spill.
- ✓ Make sure your Spill Response Plan has clear prevention and containment measures.
- ✓ Post notification and reporting procedures.
- ✓ Determine how employees and subcontractors will be trained to spill procedures.
- ✓ Dispose of all post-cleanup waste properly.
- ✓ Ensure a follow-up investigation occurs.

Fort Carson Specifics:

For any spill of 5 gallons or more:

The spill must be reported to 911, let them know you are on Fort Carson;

and

The spill must be reported to the Spill Coordinator at: 719.526.0973

BUT

▶ Take the steps on the following page first! ◀


POL SPILLS

(HAZARDOUS MATERIALS NEXT PAGE)

Step 1. If possible without endangering personnel health and safety, stop the product flow and prevent any further POL spillage.

Step 2. If it can be safely done, use onsite spill response materials to minimize or prevent the spill from entering a storm drain or storm ditch.

Step 3. If appropriate for the spill in this order, using good judgment, follow the flowchart below:

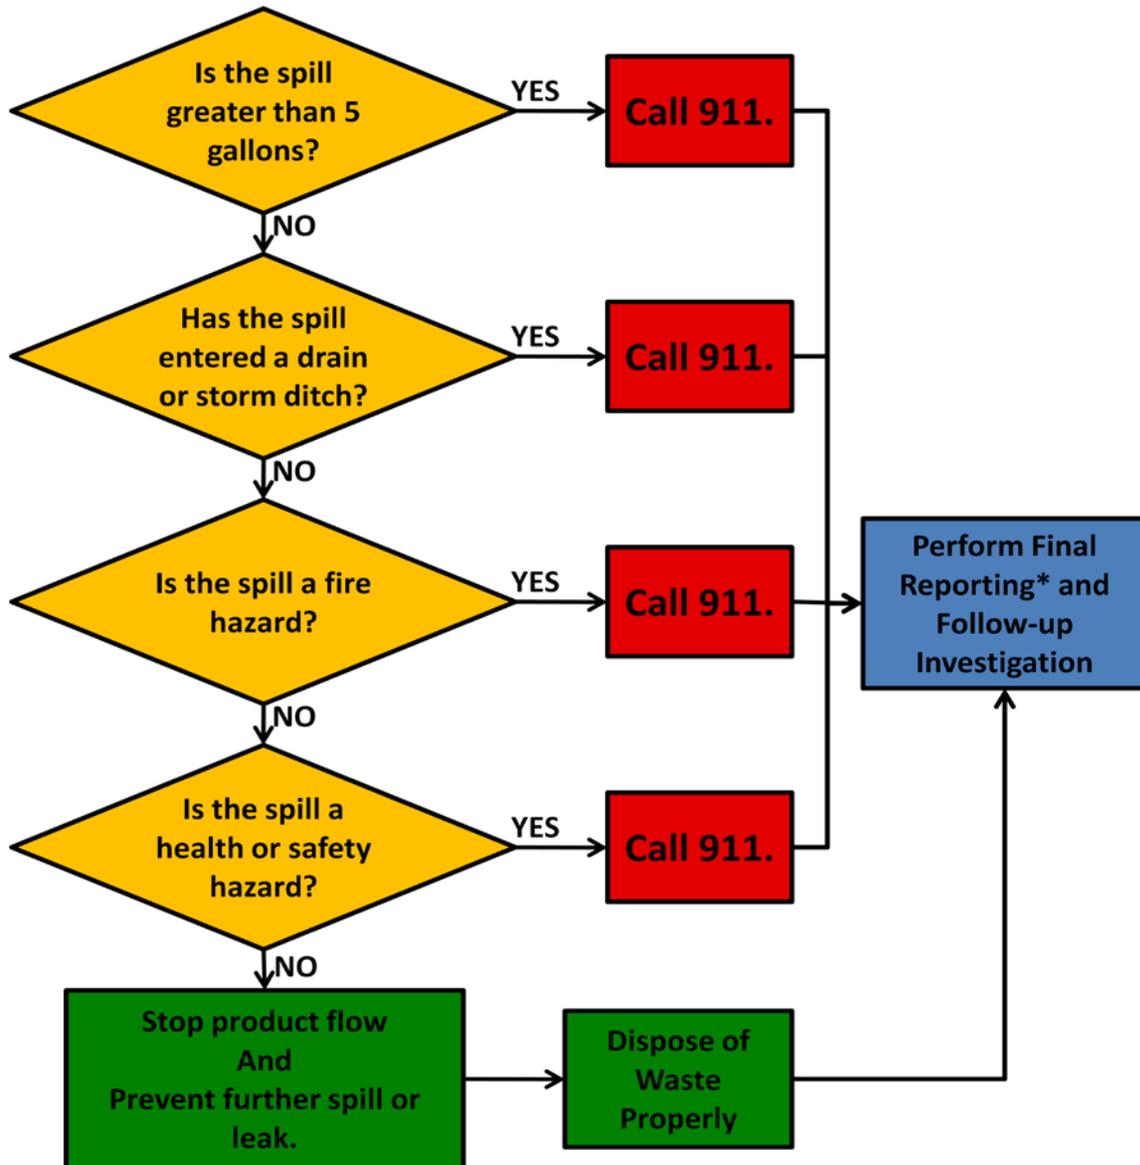

**Includes FC Form 1200-E Fort Carson Spill Report (attached)*


HAZARDOUS MATERIALS SPILLS

(POL SPILLS PREVIOUS PAGE)

Step 1. If possible without endangering personnel health and safety, stop the product flow and prevent any further POL spillage.

Step 2. If it can be safely done, use onsite spill response materials to minimize or prevent the spill from entering a storm drain or storm ditch.

Step 3. If appropriate for the spill in this order, using good judgment, follow the flowchart below:

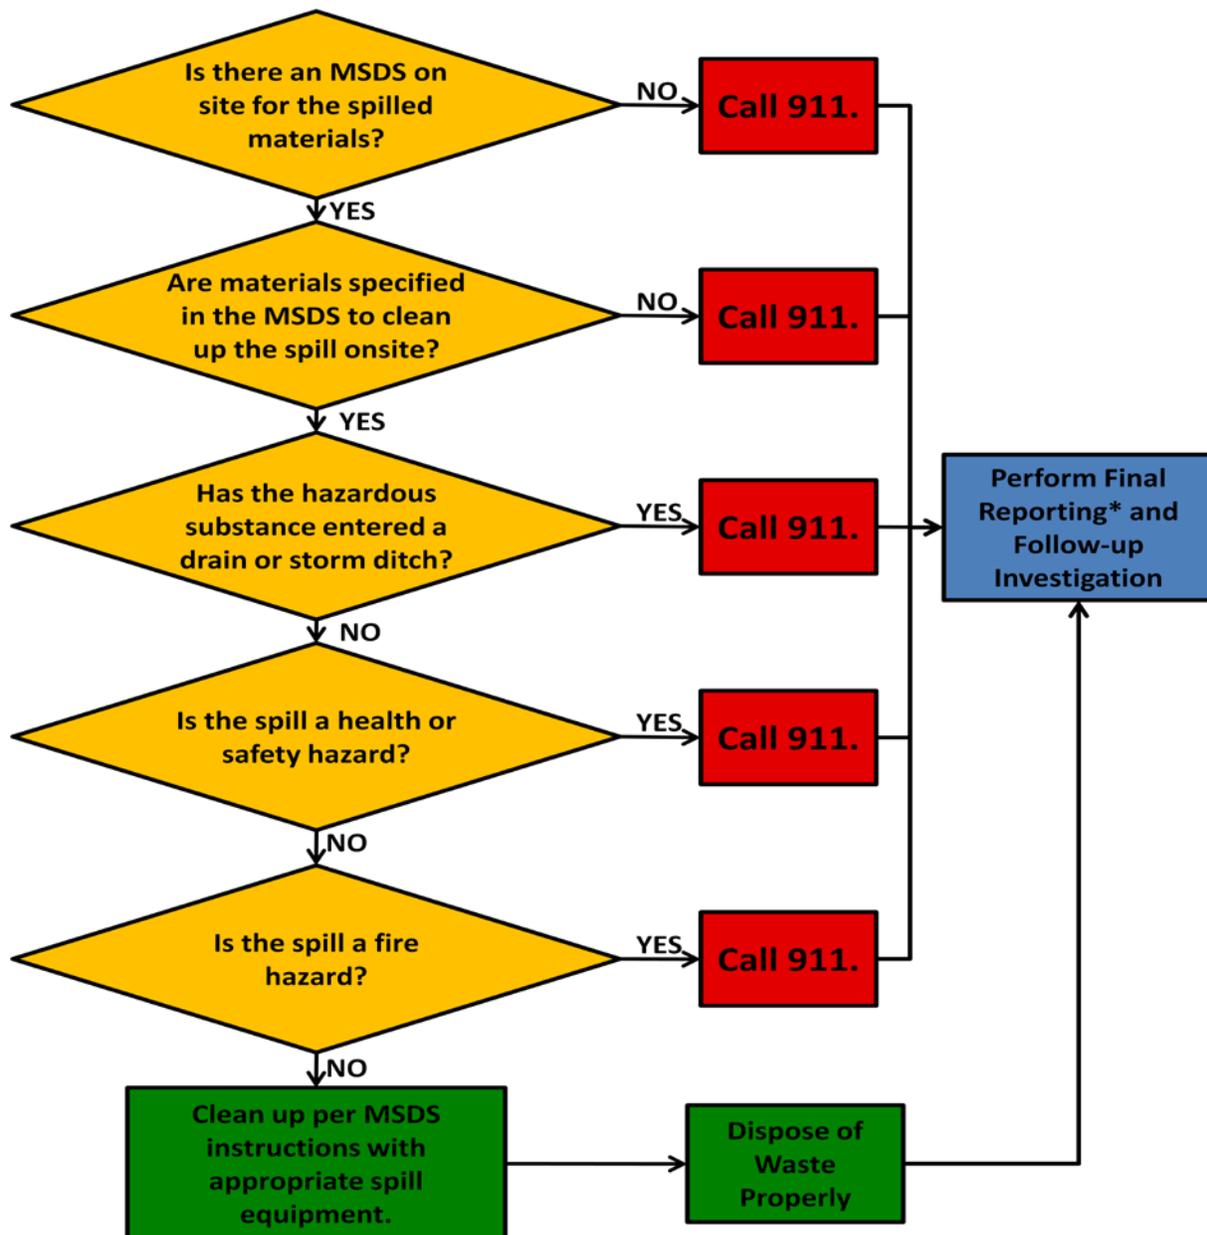

**Includes FC Form 1200-E Fort Carson Spill Report (attached).*